


Pipe Marker Installation Instructions



Ensuring the proper identification of pipes in any facility is crucial for safety, maintenance, and operational efficiency. Safety Media's Pipe Marker Stickers are designed in accordance with ASME (ANSI) A13.1-2007 and CAN/CGSB 24.3-92 standards, specifying the colors, sizes, and letter heights required for effective pipe marking. To achieve optimal visibility, pipe markers should be placed below or above the horizontal centerline of pipes located above or below the normal line of vision, and include arrows indicating the flow direction. Proper placement ensures that markers are easily visible from the point of normal approach, enhancing the safety and efficiency of your facility.

To ensure proper identification, pipes should be marked in the following manner:

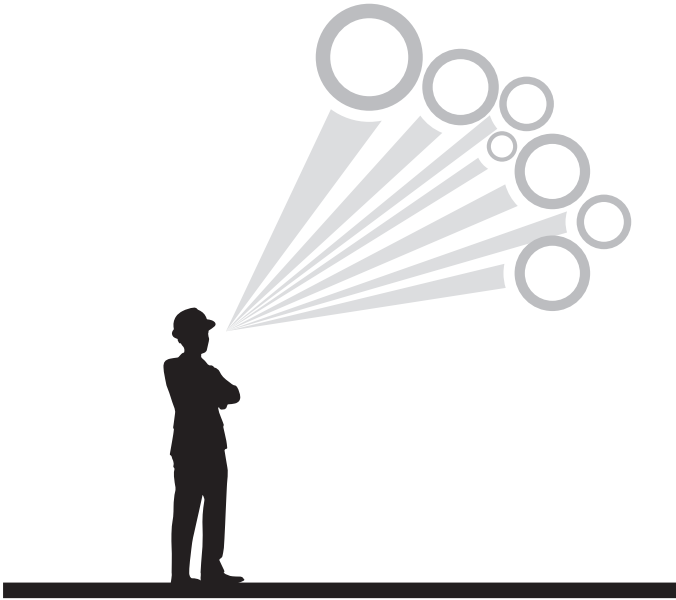

Position labels close to all valves and flanges;



Place labels on both sides of any wall, floor, or ceiling penetrations;



Apply labels at points where the pipe changes direction or branches;



Install labels at intervals of 20 to 25 feet on straight pipe runs.